检测报告



BUILDING TRUST

性能&环保
检测报告

BUILDING TRUST

220020349635

中国认可
国际互认
检测
TESTING
CNAS L1449

检　测　报　告

报告编号：JC2026WB1012

样品名称：　SikaCeram75 增强型瓷砖胶

委托单位：　西卡（上海）管理有限公司

检测类别：　型式检验

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

北京建筑材料检验研究院股份有限公司

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

北京建筑材料检验研究院股份有限公司

检 测 报 告

报告编号： JC2026WB1012

委托单位	西卡（上海）管理有限公司	检测类别	型式检验
受检单位	西卡（上海）管理有限公司	收样日期	2026年03月31日
工程名称及使用部位	——	检测日期	2026年04月03日至2026年05月15日
样品名称	SikaCeram75 增强型瓷砖胶	样品数量	5kg
型号/规格	C1	样品等级	——
生产单位	西卡（上海）管理有限公司	样品状态	粉体
生产日期/批号	——	商标	西卡
检测依据	详见数据页		
判定依据	JC/T 547-2017《陶瓷砖胶粘剂》 DB11/ 1983-2022《建筑类涂料与胶粘剂挥发性有机化合物含量限值标准》		
检测项目	拉伸粘结强度，浸水后拉伸粘结强度，热老化后拉伸粘结强度，冻融循环后拉伸粘结强度，晾置时间≥20min，拉伸粘结强度，挥发性有机化合物（VOCs）含量		
检测结论	该样品经检测，挥发性有机化合物（VOCs）含量符合DB11/ 1983-2022《建筑类涂料与胶粘剂挥发性有机化合物含量限值标准》中水基型胶粘剂（其他）的指标要求，其余检测项目符合JC/T 547-2017《陶瓷砖胶粘剂》中C1型的指标要求。 签发日期：2026年05月28日		
附注	1. 本检测结果仅对收到的样品负责； 2. 粉：水=1:0.24（重量比）。		

批 准：刘佳 审 核：张民 主 检：杨晨

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

北京建筑材料检验研究院股份有限公司

检 测 报 告

报告编号： JC2026WB1012

序号	检测项目	检测依据	指标要求	检测结果	单项判定
1	挥发性有机化合物（VOCs）含量,g/L	DB11/ 1983-2022	≤50	未检出（检出限为2）	符合
2	拉伸粘结强度,MPa	JC/T 547-2017	≥0.5	1.1	符合
3	浸水后拉伸粘结强度,MPa	JC/T 547-2017	≥0.5	0.9	符合
4	热老化后拉伸粘结强度,MPa	JC/T 547-2017	≥0.5	0.8	符合
5	冻融循环后拉伸粘结强度,MPa	JC/T 547-2017	≥0.5	0.8	符合
6	晾置时间≥20min，拉伸粘结强度,MPa	JC/T 547-2017	≥0.5	0.7	符合

序号1项目检测地址：北京市石景山区金顶北路69号；

序号2~6项目检测地址：北京市房山区窦店镇亚新路乙15号；

联系电话：4000330789、010-88724984。

（本页以下空白）

********** 结 束 **********

注意事项

1. 本报告无“检验检测专用章”或检测单位公章、骑缝章无效；
2. 部分复制本报告无效，复制后应带有防伪底纹；
3. 本报告无“主检/编制、审核、批准”签字无效；
4. 本报告涂改无效；
5. 若有异议，应于收到本报告之日起十五日内向本机构提出，逾期不予受理；
6. 委托送检样品的代表性和真实性及相关委托信息的真实性由委托方负责；委托送检报告的检测数据和结果仅对收到的样品负责；
7. 报告未加盖CMA标志时，检测数据和结果仅供科研、教学或内部质量控制之用。

北京建筑材料检验研究院股份有限公司所属检测中心

国家建筑防火产品安全质量检验检测中心

国家节水器具产品质量检验检测中心

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

国家建筑材料工业建筑五金水暖产品质量监督检验测试中心

中国轻工业联合会家具及装饰装修材料检测中心



路线备注：沿阜石路高架向西行驶，见金顶西街出口进入辅路，金安桥下右转，第二个丁字路口（第一个红绿灯）右转，直行600米路北。

扫一扫 关注我们

总　部：北京市石景山区金顶北路69号(100041)
分场所：北京市房山区窦店镇亚新路乙15号（102402）

客服热线：400-0330-789
客服传真(Fax)：010-8871 5189
网址(Web)：www.bmtbj.cn

真伪查询专线：400-0330-789
真伪查询邮箱：chaxun@bmtbj.cn
投诉邮箱：tousu@bmtbj.cn

法国A+
检测报告

BUILDING TRUST

TEST REPORT

APPLICANT	:	**SIKA (SHANGHAI) MANAGEMENT CO., LTD.**
ADDRESS	:	ROOM 102,NO.252,JIANGCHANG 3RD ROAD , JING'AN DISTRICT SHANGHAI CHINA.
TESTED SAMPLE DESCRIPTION	:	SIKACERAM®-75 PROFESSIONAL TILE ADHESIVE
TESTED STYLE / ITEM NO.	:	NA
SUPPLIER	:	NA
COUNTRY OF ORIGIN	:	NA
COUNTRY OF DESTINATION	:	NA
SAMPLE RECEIVED DATE	:	JUL. 29, 2022
TEST PERIOD	:	JUL. 29, 2022 TO SEP. 20, 2022
RESULT SUMMARY	:	

TEST(S) REQUESTED BY APPLICANT:	RESULT
French VOC Regulation	A+

**********FOR FURTHER DETAILS, PLEASE REFER TO THE FOLLOWING PAGE(S)**********

SIGNED FOR AND ON BEHALF OF
EUROFINS TESTING TECHNOLOGY (SHENZHEN) CO., LTD.

James Luo
Senior VOC Testing Engineer

Jack Lu
Senior Operations Manager

Eurofins Testing Technology (Shenzhen) Co., Ltd. 欧陆检测技术(深圳)有限公司 检测专用章 Testing Service

The above sample(s) and sample information was/were submitted and identified on behalf of the applicant. Eurofins will not be liable for the authenticity of the information. This test report is valid for the tested sample only. Without permission of the test center this test report is not permitted to be duplicated in extracts. This test report does not entitle to carry any safety mark on this or similar products.


Test Method

Method	Principle	Parameter	Detection Limit	Uncertainty
ISO 16000 parts -3, -6, -9, -11	TDS-GC/MS	VOC CMR	5 µg/m³ 1 µg/m³	17.5% (RSD) U = 2 x RSD= 35%
	HPLC/UV	Volatile aldehydes	5 µg/m³	16% (RSD) U = 2 x RSD= 32%

Test chamber parameter					
Chamber volume (L):	119	Temperature (°C):	23	Relative humidity (%):	50
Air change rate (per hour):	0.5	Loading ratio (m^2/m^3)	1.4		
Test condition: Sample stayed in test chamber during the whole 28 days testing period.					
Sample preparation					
Application (g/m^2):		2000			
Powder (g):Water (g)		1:0.24			

Resulting VOC Emissions Class Label

This recommendation is based on French regulation as published on 25 March 2011 (décret DEVL1101903D) and on 13 May 2011 (arrêté DEVL1104875A). For details please see www.eurofins.com/france-voc.

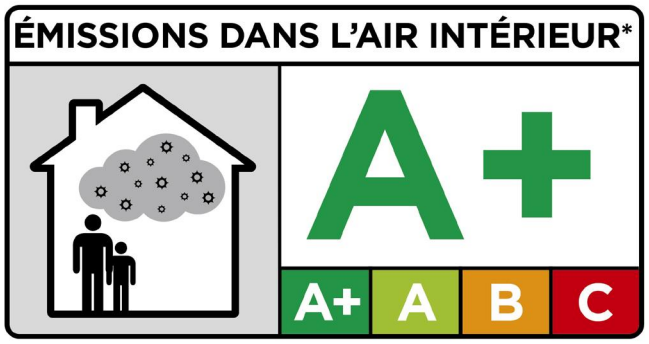

Information sur le niveau d'émission de substances volatiles dans l'air intérieur, présentant un risque de toxicité par inhalation, sur une échelle de classe allant de A+ (très faibles émissions) à C (fortes émissions)

The tested product **fulfills** the requirements of the French regulation DEVP09908633A of 30 April 2009 and DEVPP0910046A of 28 May 2009. For details please see www.eurofins.com/france-voc.

TO BE CONTINUED

Test Result

	Concentration after 28 days µg/m³	C	B	A	A+
TVOC	<20	>2000	<2000	<1500	<1000
Formaldehyde	<5	>120	<120	<60	<10
Acetaldehyde	<5	>400	<400	<300	<200
Toluene	<5	>600	<600	<450	<300
Tetrachloroethylene	<5	>500	<500	<350	<250
Ethylbenzene	<5	>1500	<1500	<1000	<750
Xylene	<5	>400	<400	<300	<200
Styrene	<5	>500	<500	<350	<250
2-Butoxyethanol	<5	>2000	<2000	<1500	<1000
Trimethylbenzene	<5	>2000	<2000	<1500	<1000
1,4-Dichlorobenzene	<5	>120	<120	<90	<60
CMR compounds		Maximum allowed air concentration			
Benzene	<1	<1			
Trichloroethylene	<1	<1			
Dibutyl phthalate (DBP)	<1	<1			
Diethylhexyl phthalate (DEHP)	<1	<1			

Remark:
< Means less than
> Means higher than

This VOCs test covered only substances that can be adsorbed on Tenax-TA and that can be thermally desorbed and analyzed by gas chromatography mass spectrometric detector. If other emission occurred then these could not be monitored or with limited reliability only. The method is not optimal for very volatile compounds. For these substances small results and a higher uncertainty in the measurement cannot be excluded. VOCs without pure standards were identified by comparison with a mass spectrum obtained from a library. Calibrated as toluene equivalent.

Note:
The chamber test and analyses were done in Eurofins Testing Technology (Shenzhen) Co., Ltd.

Other Information / Remark:

N/A

TO BE CONTINUED

Photo Attachment
SIKACERAM®-75 PROFESSIONAL TILE ADHESIVE


END OF THE REPORT